

6/1/2016

Detroit Health Department  
3245 E. Jefferson Ave, Suite 100  
Detroit, MI 48207

Subject: **Stewart Performance Academy**  
**13120 Wildemere St.**  
**Detroit, MI 48238**

Dear Detroit Health Department:

After reviewing all of the data from the initial testing which included three sources, and the second round of testing, which included the remaining sources there are two locations in the school which have exceedances above the MCL for lead:

The drinking water fountains near 125 (Samples 10,11,2 on diagram) –

The drinking water fountains near 218 (Samples 19 on diagram) – 19 is the right drinking fountain when facing the fountains.

Short Term Plan:


Keep drinking fountains near 125 and 218 covered. All other drinking fountains will be uncovered and resume use. All remaining fixtures will begin weekly flushes beginning on 6/2/16.

Mitigation Plan:

Taking the two fixtures out of service permanently

Implementing a flush plan which consists of running the water on each drinking fountain and fixture for 2-3 minutes daily. A log book will be kept to document the date and time of when the water is being flushed.

Sincerely,

  
**Stephanie Widner**

# STEWART

## Fire Escape Plan FIRST FLOOR

1-DWF-F-STEW(CR)  
1-DWF-P-STEW(CR)


4-DWF-P-SA  
4-DWF-F-SA  
3-DWF-P-SA  
3-DWF-F-SA

1-DWF-P-SA  
1-DWF-F-SA  
2-DWF-P-SA  
2-DWF-F-SA

7-DWF-P-SA  
7-DWF-F-SA

5-DWF-P-SA  
5-DWF-F-SA  
6-DWF-P-SA  
6-DWF-F-SA

MAP NOT TO SCALE  
ASTERISK (\*) DENOTES POSITIVE AREA

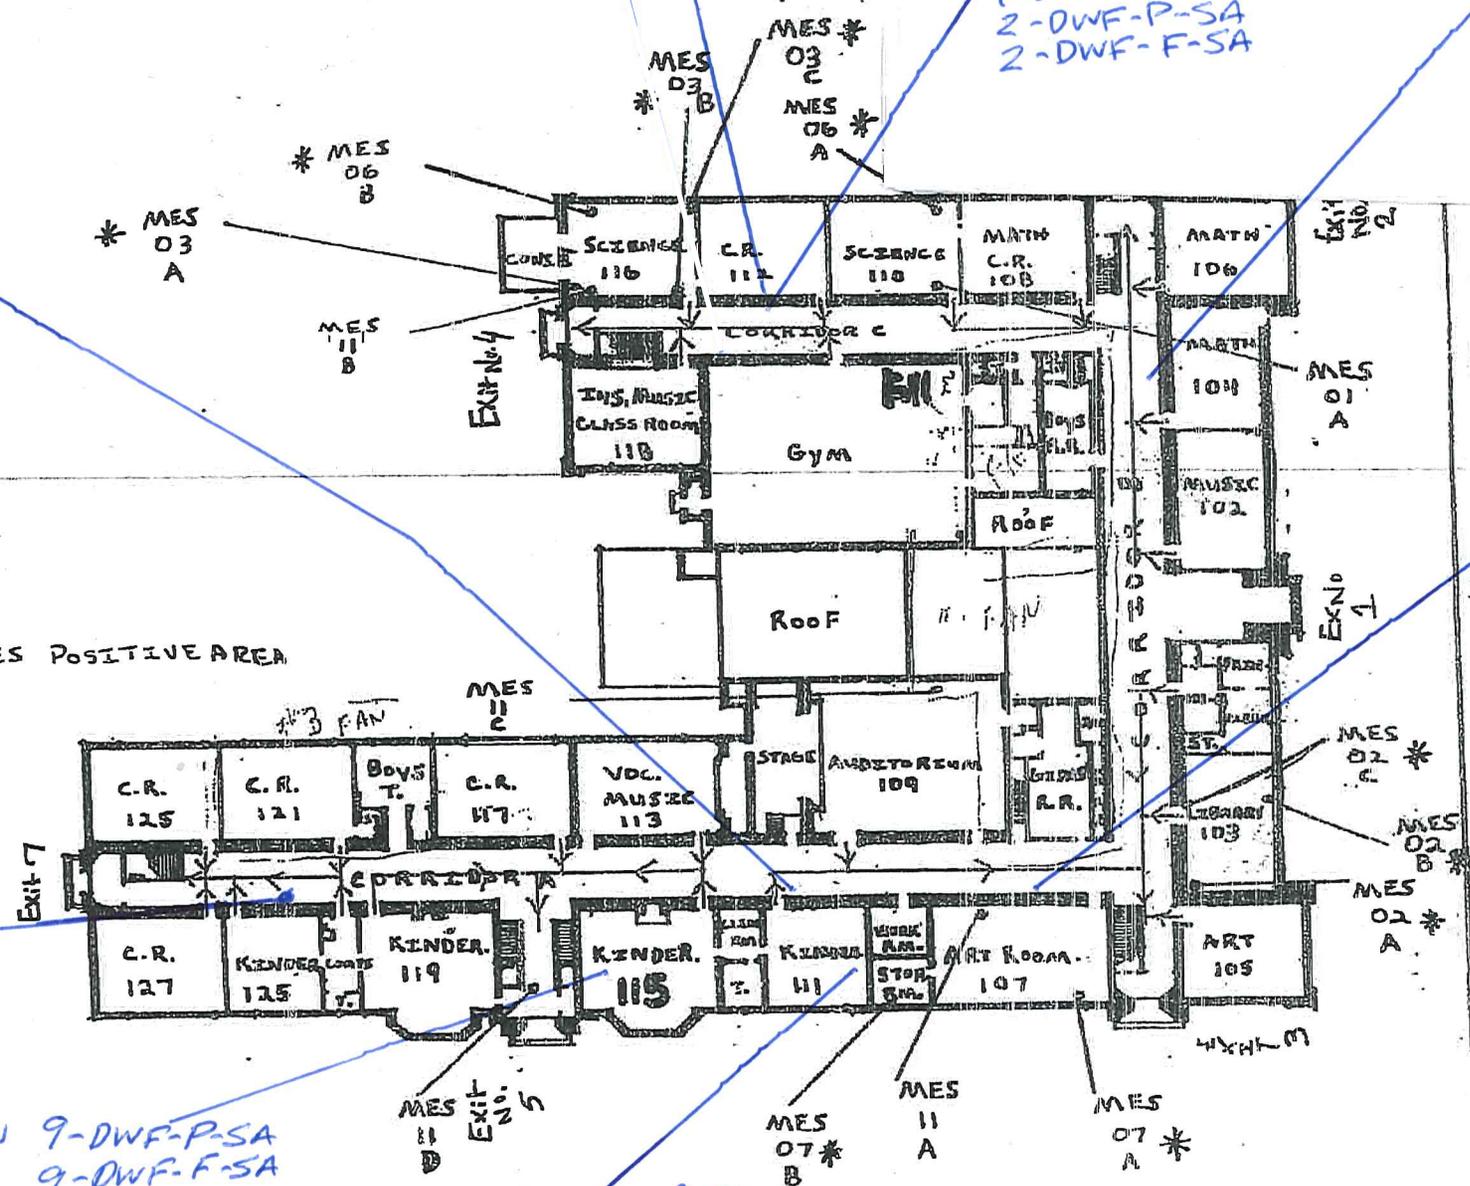

10-DWF-P-SA  
10-DWF-F-SA  
11-DWF-P-SA  
11-DWF-F-SA  
2-DWF-P-STEW  
2-DWF-F-STEW

9-DWF-P-SA  
9-DWF-F-SA

8-DWF-P-SA  
8-DWF-F-SA



# STEWART

Fire Escape Plan

## SECOND FLOOR


(218 HALL)  
18-DWF-P-SA  
18-DWF-F-SA  
19-DWF-P-SA  
19-DWF-F-SA

(211 HALL)  
14-DWF-P-SA  
14-DWF-F-SA

(207 HALL)  
15-DWF-P-SA  
15-DWF-F-SA

(204 HALL)  
16-DWF-P-SA  
16-DWF-F-SA  
17-DWF-P-SA  
17-DWF-F-SA

225 HALL  
12-DWF-P-SA  
12-DWF-F-SA  
13-DWF-P-SA  
13-DWF-F-SA

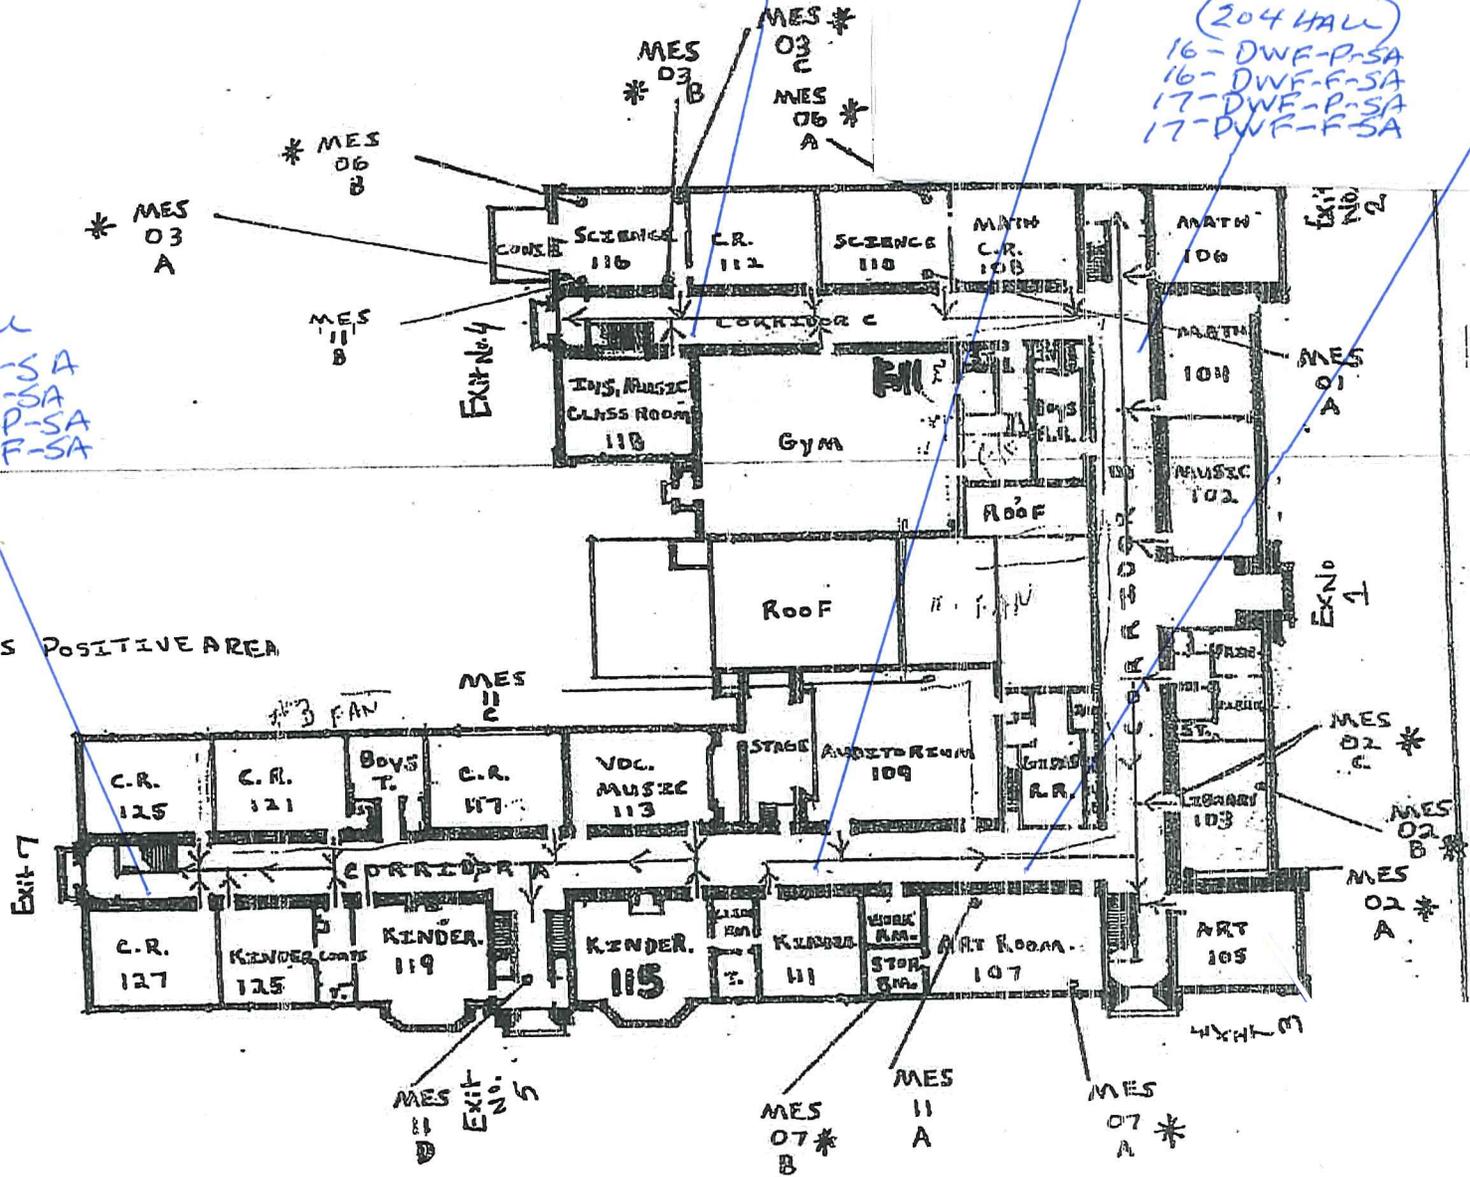

MAP NOT TO SCALE  
ASTERISK (\*) DENOTES POSITIVE AREA